




SURGE PROTECTOR

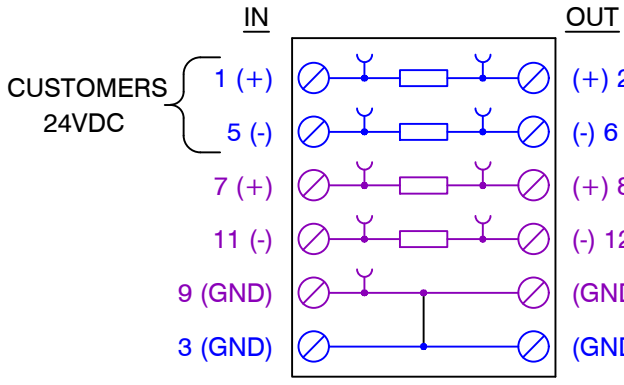

Blue Indicates Circuit 1
Purple Indicates Circuit 2

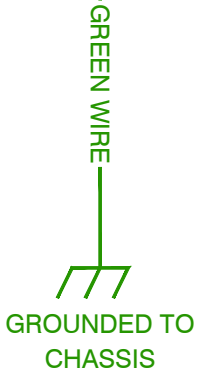

EST 3-EVPWRA POWER MODULE

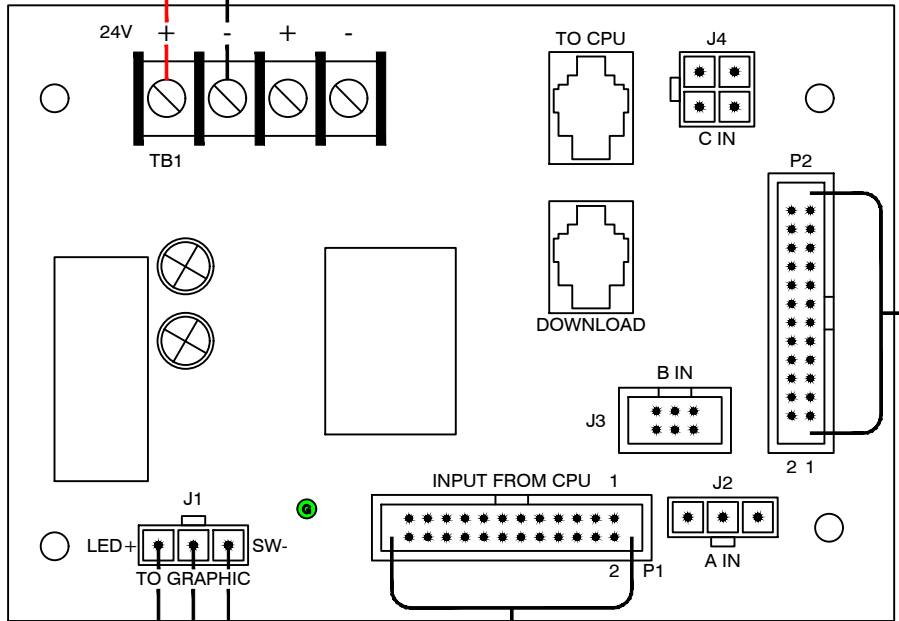

From 3-ANNCPU, P3
EST Cable P/N: 46050-1878

To Kulka Terminal Block TB1
(See Sheet CAP-8646C (EST-3))
(See Sheet CAP-8697C (EST-4))

To 3-EVDVR #1, (J2)
EST Cable P/N: 46050-1877
(See Sheet CAP-8646C (EST-3))
(See Sheet CAP-8697C (EST-4))

<h2>DRIVER DIAGRAM</h2>		H. R. KIRKLAND CO., INC. 4935 Allison Street, Unit 13 Arvada, Colorado 80002 Phone: (800) 247-2303 Fax: (303) 420-1856
	SURGE PROTECTOR CONNECTION TO 3-EVPWRA (EDWARDS EST-3 / EST-4)	
DATE: 24 FEB 2021 BY GG REVISION: ORIGINAL		<h1>CAP-8698</h1>